

STT 3000 Smart Temperature Transmitter Series STT170

STT171, STT173, STT17H, STT17F, STT17C

34-TT-03-07
January 2009

Specification and Model Selection Guide

OVERVIEW

The Honeywell STT170 series of programmable temperature transmitters provides cost effective solutions for temperature monitoring applications. Compared to direct-wired temperature sensor monitoring points, the STT170 series of transmitters delivers increased accuracy, safety and reliability while also reducing wiring costs. These transmitters automatically linearize the temperature output signal bounded by the upper range value and lower range value established by the user. In addition, the user can program high or low limit alarms to activate in the case of sensor failure.

STT171 FEATURES

- Analog 4-20 mA output
- RTD or Ohm input
- DIN form B headmount
- NAMUR NE43 sensor error response
- Configurable using STT17C configuration tool and PC



STT173 FEATURES

- Analog 4-20 mA output
- RTD, T/C, Ohm or mV input
- DIN form B headmount
- NAMUR NE43 sensor error response
- Configurable using STT17C configuration tool and PC
- Galvanic isolation



STT17H FEATURES

- HART™/4-20 mA output
- RTD, T/C, Ohm or mV input
- Single or dual (difference or average) sensor input
- DIN form B headmount
- HART Multidrop capable
- NAMUR NE43 sensor error response
- Configurable using STT17C configuration tool and PC or HART field communicator
- Galvanic isolation




STT17F FEATURES

- FOUNDATION™ fieldbus protocol
- RTD, T/C, Ohm or mV input
- Single or dual (difference, average or redundant) sensor input
- DIN form B headmount
- Function blocks: 2 analogue, 1 PID
- FISCO certified
- Basic or LAS capability
- Galvanic isolation




HART is a registered trademark of the HART Communication Foundation.
FOUNDATION is a registered trademark of the Fieldbus Foundation.

Dimensions (all models)

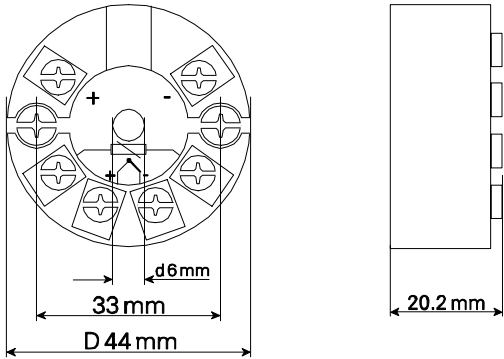



Wiring

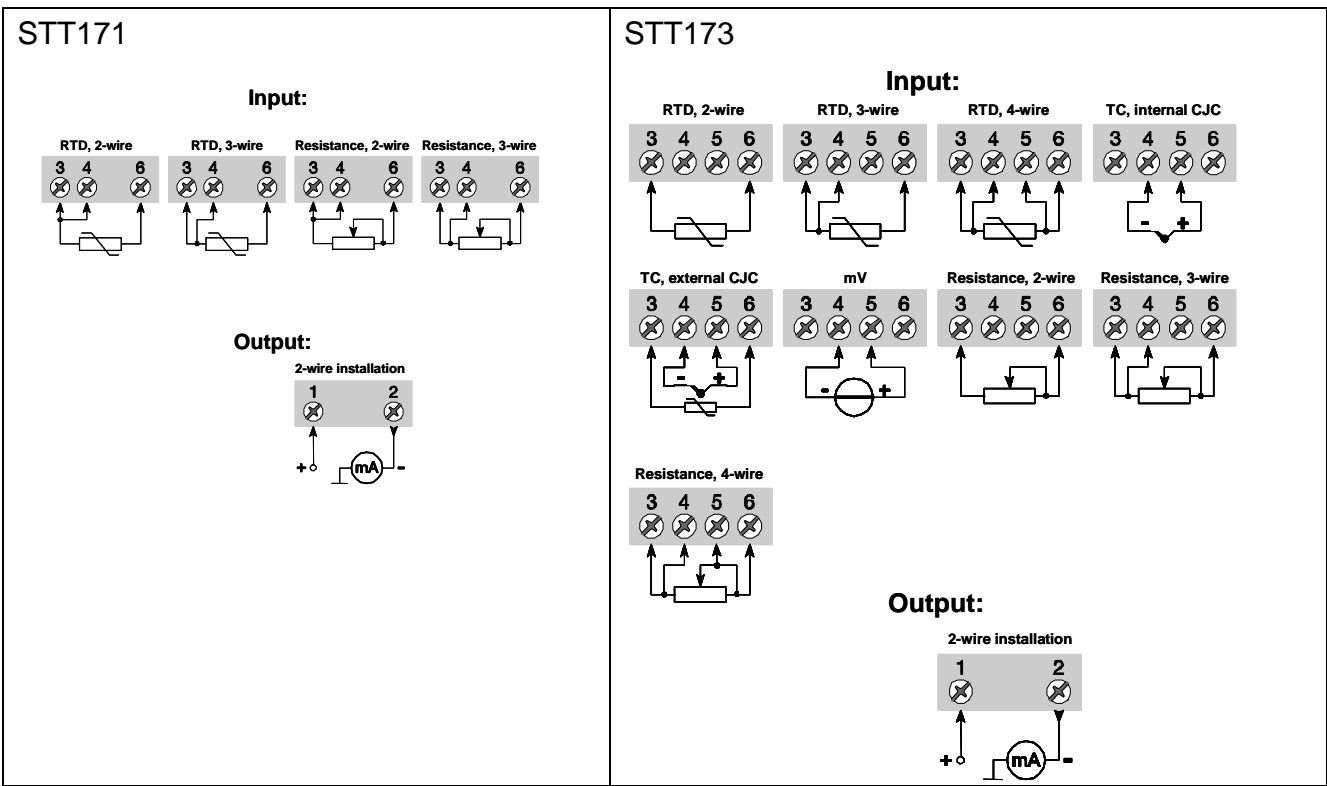


Wiring

STT17H

Input:

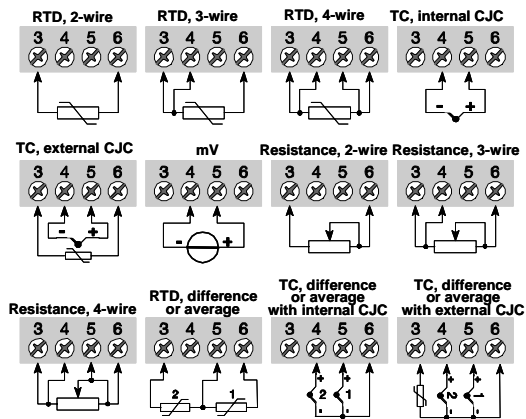


Output:




STT17F

Input:

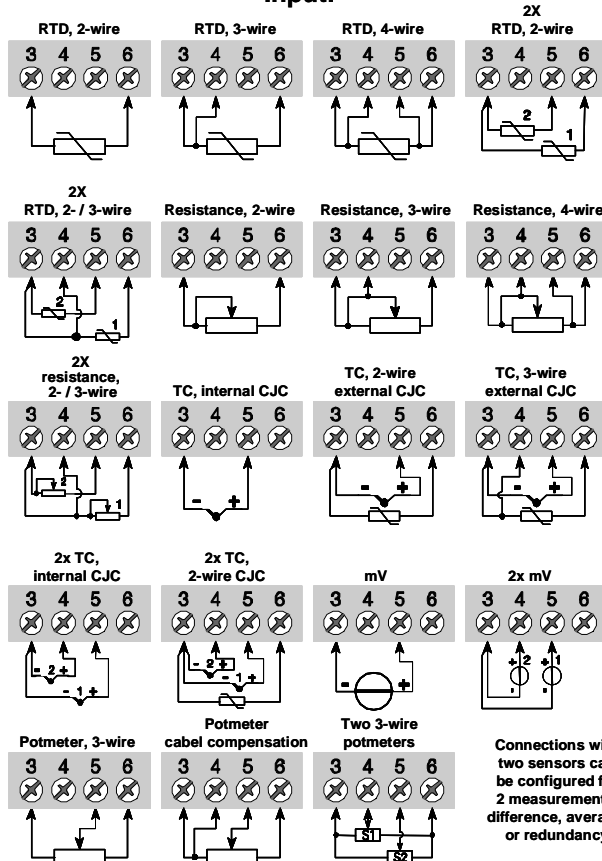

Connections with two sensors can be configured for 2 measurements, difference, average, or redundancy

Output:

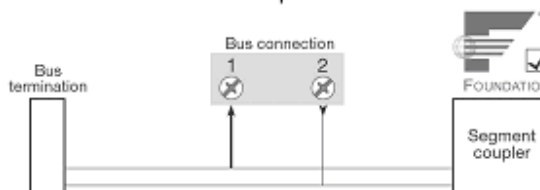

STT17C Configuration tool



The STT17C configures the STT171, STT173 and STT17H. The intuitive graphical user interface of the STT17C virtually eliminates the need for operator training after installation on a PC. The STT17C includes all software and transmitter interface hardware necessary to configure the STT171, STT173 and STT17H in non-hazardous work environments.

WARNING: The STT17C is not approved for use in Hazardous work environments.

System Requirements:

Windows® 98SE, ME, 2000 and XP with the following recommendations:

Memory: 16 MB
Display resolution: 800 x 600
Hard disk space: 12 MB

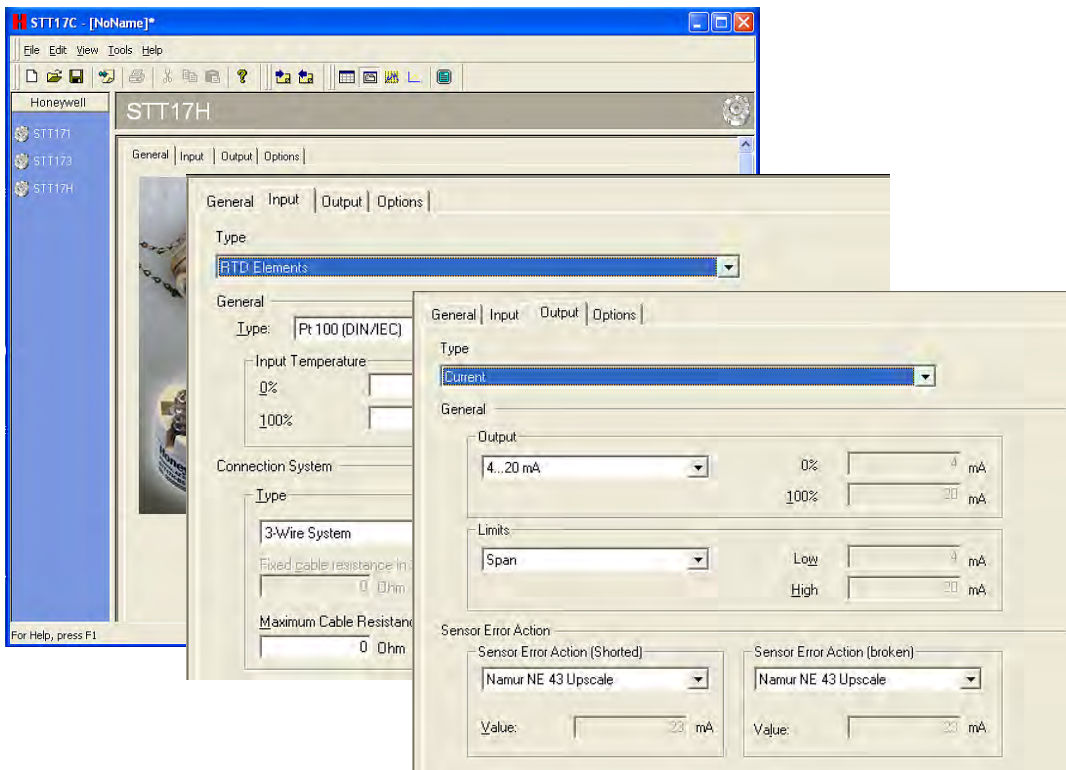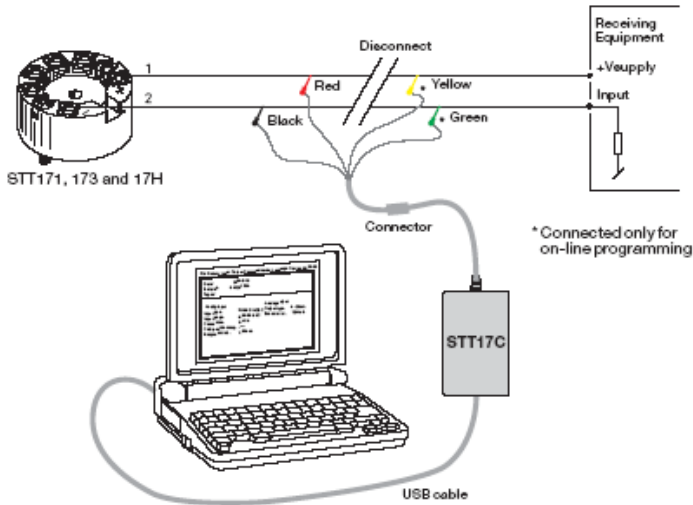

STT171-BS Specifications

Sensor Type	Basic Accuracy*		Rated Range		Standards	Minimum Span**	Temperature Effects per 1.0°C (1.8°F) Change in Ambient Temperature***	
	Fixed	% of Span	°C	°F			Fixed	% of Span
Pt100	0.3°C (0.54°F)	± 0.1	-200 to 850	-328 to 1562	IEC60751	25°C (45°F)	0.01°C (0.018°F)	±0.01
Ni100	0.3°C (0.54°F)	± 0.1	-60 to 250	-76 to 482	DIN 43760	25°C (45°F)	0.01°C (0.018°F)	±0.01
Ω	0.2 Ω	± 0.1	0 to 10000 Ω			30 Ω	20 mΩ	±0.01

*whichever is greater; Total Reference Accuracy = Basic Accuracy

**or 50% of upper range value, whichever is greater

*** reference temperature 24°C

OPERATING CONDITIONS

Ambient temperature, rated.....-40 to 85°C (-40 to 185°F)
 Humidity..... 0 to 95% RH (non-cond.)
 Vibration..... Max 4g over 25 to 100Hz

ELECTRICAL INPUT SPECIFICATIONS

Supply voltage..... 8 to 30 VDC
 Power supply voltage effect..... ≤ 0.005% of span per VDC
 Warm-up time..... 5 min
 Response time (programmable)..... 0.33 to 60 sec

CURRENT OUTPUT SPECIFICATIONS

Signal output range..... 4 to 20 mA
 Update time..... 135 msec
 Load resistance..... ≤(V supply - 8) / 0.023 A
 0 to 870 Ω

ALARM LEVELS


Programmable..... 3.5 to 4 mA downscale
 20 to 23 mA upscale
 NAMUR NE43 Upscale..... 23 mA
 NAMUR NE43 Downscale..... 3.5 mA

APPROVALS

Observed Authority requirements:

EMC 2004/108/EC
 Emmission and immunity EN 61326
 ATEX 94/9/EC..... EN 50014, EN 50020,
 EN 50281-1-1 and EN 50284
 FM, ASCN..... 3600, 3611, 3610
 CSA, CAN / CSA..... C22.2 No. 157, E60079-11,
 UL 913

Ex / I.S. approval:

KEMA 06 ATEX 0042 X.....  II 1 GD, T80°C...T105°C
 EEx ia IIC T4...T6
 Max. amb. Temperature for T4..... 85°C
 Max. amb. Temperature for T6..... 60°C
 Applicable in zone..... 0, 1, 2, 20, 21 or 22
 FM, applicable in..... IS, CL I, DIV 1, Grp. A-D, T4...T6
 AEx ia IIC
 NI, CL I, DIV 2, Grp. A-D, T4...T6
 Entity, FM Installation Drawing No..... 50016324
 CSA, applicable in..... IS, CL I, DIV 1, Grp. A-D, T4...T6
 Ex ia IIC, AEx ia IIC
 Entity, Installation Drawing No..... 50016326

Ex / I.S. data:

U_i (max)..... 30 VDC
 I_i (max)..... 120 mADC
 P_i (max)..... 0.84 W
 L_i (max)..... 10 μH
 C_i (max)..... 1.0 nF
 U_o (max)..... 27 VDC
 I_o (max)..... 7 mADC
 P_o (max)..... 45 m W
 L_o (max)..... 35 mH
 C_o (max)..... 90 nF

STT173-BS Specifications

Sensor Type	Basic Accuracy*		Rated Range		Standards	Minimum Span**	Temperature Effects per 1.0°C (1.8°F) Change in Ambient Temperature***	
	Fixed	% of Span	°C	°F			Fixed	% of Span
Pt100	0.2°C (0.36°F)	± 0.1	-200 to +850	-328 to +1562	IEC60751	25°C (45°F)	0.01°C (0.018°F)	±0.01
Ni100	0.2°C (0.36°F)	± 0.1	-60 to +250	-76 to +482	DIN 43760	25°C (45°F)	0.01°C (0.018°F)	±0.01
B	2°C (3.6°F)	± 0.1	+400 to +1820	+752 to +3308	IEC584	200°C (360°F)	0.2°C (0.36°F)	±0.01
E	1°C (1.8°F)	± 0.1	-100 to +1000	-148 to +1832	IEC584	50°C (90°F)	0.05°C (0.09°F)	±0.01
J	1°C (1.8°F)	± 0.1	-100 to +1200	-148 to +2192	IEC584	50°C (90°F)	0.05°C (0.09°F)	±0.01
K	1°C (1.8°F)	± 0.1	-180 to +1372	-192 to +2502	IEC584	50°C (90°F)	0.05°C (0.09°F)	±0.01
L	1°C (1.8°F)	± 0.1	-100 to +900	-148 to +1652	DIN 43710	50°C (90°F)	0.05°C (0.09°F)	±0.01
N	1°C (1.8°F)	± 0.1	-180 to +1300	-292 to +2372	IEC584	100°C (180°F)	0.05°C (0.09°F)	±0.01
R	2°C (3.6°F)	± 0.1	-50 to +1760	-58 to +3200	IEC584	200°C (360°F)	0.2°C (0.36°F)	±0.01
S	2°C (3.6°F)	± 0.1	-50 to +1760	-58 to +3200	IEC584	200°C (360°F)	0.2°C (0.36°F)	±0.01
T	1°C (1.8°F)	± 0.1	-200 to +400	-328 to +752	IEC584	50°C (90°F)	0.05°C (0.09°F)	±0.01
U	1°C (1.8°F)	± 0.1	-200 to +600	-328 to +1112	DIN 43710	75°C (135°F)	0.05°C (0.09°F)	±0.01
W3	2°C (3.6°F)	± 0.1	0 to +2300	+32 to +4172	ASTM E988-90	200°C (360°F)	0.2°C (0.36°F)	±0.01
W5	2°C (3.6°F)	± 0.1	0 to +2300	+32 to +4172	ASTM E988-90	200°C (360°F)	0.2°C (0.36°F)	±0.01
Ω	0.1 Ω	± 0.1	0 to 5000 Ω			30 Ω	10 mΩ	±0.01
mV	10 μV	± 0.1	-12 to 800 mV			5 mV	1 μV	±0.01

*whichever is greater; Total Reference Accuracy = Basic Accuracy + CJ Accuracy (T/C only)

**or 50% of upper range value, whichever is greater

*** reference temperature 24°C

OPERATING CONDITIONS

Ambient temperature, rated..... -40 to 85°C (-40 to 185°F)
 Humidity..... 0 to 95% RH (non-cond.)
 Vibration..... Max 4g over 25 to 100Hz
 Cold junction accuracy..... ±1.0°C

ELECTRICAL INPUT SPECIFICATIONS

Supply voltage..... 7.2 to 30 VDC
 Power supply voltage effect..... ≤ 0.005% of span per VDC
 Warm-up time..... 5 min
 Response time (programmable)..... 1 to 60 sec
 Galvanic isolation..... 1500 VAC

CURRENT OUTPUT SPECIFICATIONS

Signal output range..... 4 to 20 mA
 Update time..... 440 msec
 Load resistance (Ω)..... ≤(V supply - 7.2) / 0.023 A
 0 to 904 Ω

ALARM LEVELS

Programmable..... 3.5 to 4 mA downscale
 20 to 23 mA upscale
 NAMUR NE43 Upscale..... 23 mA
 NAMUR NE43 Downscale..... 3.5mA

APPROVALS

Observed Authority requirements:

EMC 2004/108/EC

Emmission and immunity EN 61326

ATEX 94/9/EC..... EN 50014, EN 50020

FM, ASCN..... 3600, 3611, 3610

CSA, CAN / CSA..... C22.2 No. 157, E60079-11,
 UL 913

Ex / I.S. approval:

KEMA 06 ATEX 0063 X.....  II 1 GD, T80°C...T105°C

EEEx ia IIC T4...T6

Max. amb. Temperature for T4..... 85°C

Max. amb. Temperature for T6..... 60°C

Applicable in zone..... 0, 1, 2, 20, 21 and 22

FM, applicable in..... IS, CL I, DIV 1, Grp. A-D, T4...T6

AEx ia IIC

NI, CL I, DIV 2, Grp. A-D, T4...T6

Entity, FM Installation Drawing No..... 50016324

CSA, applicable in..... IS, CL I, DIV 1, Grp. A-D, T4...T6

Ex ia IIC, AEx ia IIC

Entity, Installation Drawing No..... 50016326

Ex / I.S. data:

U_i (max)..... 30 VDC

I_i (max)..... 120 mADC

P_i (max)..... 0.84 W

L_i (max)..... 10 μH

C_i (max)..... 1.0 nF

U_o (max)..... 9.6 VDC

I_o (max)..... 25 mADC

P_o (max)..... 60 m W

L_o (max)..... 33 mH

C_o (max)..... 3.6 μF

STT17H-BS Specifications

Sensor Type	Basic Accuracy*		Rated Range		Standards	Minimum Span**	Temperature Effects per 1.0°C (1.8°F) Change in Ambient Temperature***	
	Fixed	% of Span	°C	°F			Fixed	% of Span
Pt100	0.2°C (0.36°F)	± 0.1	-200 to +850	-328 to +1562	IEC60751	10°C (18°F)	0.01°C (0.018°F)	±0.01
Pt1000	0.2°C (0.36°F)	± 0.1	-200 to +850	-328 to +1562	IEC60751	10°C (18°F)	0.01°C (0.018°F)	±0.01
Ni100	0.3°C (0.54°F)	± 0.1	-60 to +250	-76 to +482	DIN 43760	10°C (18°F)	0.01°C (0.018°F)	±0.01
B	1°C (1.8°F)	± 0.1	+400 to +1820	+752 to +3308	IEC584	100°C (180°F)	0.2°C (0.36°F)	±0.01
E	0.5°C (0.9°F)	± 0.1	-100 to +1000	-148 to +1832	IEC584	50°C (90°F)	0.05°C (0.09°F)	±0.01
J	0.5°C (0.9°F)	± 0.1	-100 to +1200	-148 to +2192	IEC584	50°C (90°F)	0.05°C (0.09°F)	±0.01
K	0.5°C (0.9°F)	± 0.1	-180 to +1372	-192 to +2502	IEC584	50°C (90°F)	0.05°C (0.09°F)	±0.01
L	0.5°C (0.9°F)	± 0.1	-100 to +900	-148 to +1652	DIN 43710	50°C (90°F)	0.05°C (0.09°F)	±0.01
N	0.5°C (0.9°F)	± 0.1	-180 to +1300	-292 to +2372	IEC584	50°C (90°F)	0.05°C (0.09°F)	±0.01
R	1°C (1.8°F)	± 0.1	-50 to +1760	-58 to +3200	IEC584	100°C (180°F)	0.2°C (0.36°F)	±0.01
S	1°C (1.8°F)	± 0.1	-50 to +1760	-58 to +3200	IEC584	100°C (180°F)	0.2°C (0.36°F)	±0.01
T	0.5°C (0.9°F)	± 0.1	-200 to +400	-328 to +752	IEC584	50°C (90°F)	0.05°C (0.09°F)	±0.01
U	0.5°C (0.9°F)	± 0.1	-200 to +600	-328 to +1112	DIN 43710	50°C (90°F)	0.05°C (0.09°F)	±0.01
W3	1°C (1.8°F)	± 0.1	0 to +2300	+32 to +4172	ASTM E988-90	100°C (180°F)	0.2°C (0.36°F)	±0.01
W5	1°C (1.8°F)	± 0.1	0 to +2300	+32 to +4172	ASTM E988-90	100°C (180°F)	0.2°C (0.36°F)	±0.01
Ω	0.1 Ω	± 0.1	0 to 7000 Ω			25 Ω	5 mΩ	±0.01
mV	10 μV	± 0.1	-800 to 800 mV			5 mV	0.5 μV	±0.01

*whichever is greater; Total Reference Accuracy = Basic Accuracy + CJ Accuracy (T/C only)

**or 50% of upper range value, whichever is greater

*** reference temperature 24°C

OPERATING CONDITIONS

Ambient temperature, rated..... -40 to 85°C (-40 to 185°F)
 Humidity..... 0 to 95% RH (non-cond.)
 Vibration..... Max 4g over 25 to 100Hz
 Cold junction accuracy..... ±1.0°C

ELECTRICAL INPUT SPECIFICATIONS

Supply Voltage..... 8 to 30 VDC
 Power supply voltage effect..... ≤ 0.005% of span per VDC
 Warm-up time..... 30 sec
 Response time (programmable)..... 1 to 60 sec
 Galvanic isolation..... 1500 VAC


CURRENT OUTPUT SPECIFICATIONS

Signal output range..... 4 to 20 mA
 Update time..... 440 msec
 Load resistance (Ω)..... ≤(V supply - 8) / 0.023 A
 0 to 870 Ω

ALARM LEVELS

Programmable..... 3.5 to 4 mA downscale
 20 to 23 mA upscale
 NAMUR NE43 Upscale..... 23 mA
 NAMUR NE43 Downscale..... 3.5 mA

APPROVALS

Observed Authority requirements: **Standard:**
 EMC 2004/108/EC
 Emmission and immunity EN 61326
 ATEX 94/9/EC..... EN 50014, EN 50020,
 EN 50281-1-1 and EN 50284
 FM, ASCN..... 3600, 3611, 3610
 CSA, CAN / CSA..... C22.2 No. 157, E60079-11,
 UL 913
Ex / I.S. approval:
 KEMA 06 ATEX 0044 X.....  II 1 GD, T80°C...T105°C
 EEx ia IIC T4...T6
 Max. amb. Temperature for T4..... 85°C
 Max. amb. Temperature for T6..... 60°C
 Applicable in zone..... 0, 1, 2, 20, 21 or 22
 FM, applicable in..... IS, CL I, DIV 1, Grp. A-D, T4...T6
 AEx ia IIC
 NI, CL I, DIV 2, Grp. A-D, T4...T6
 Entity, FM Installation Drawing No..... 50016324
 CSA, applicable in..... IS, CL I, DIV 1, Grp. A-D, T4...T6
 Ex ia IIC, AEx ia IIC
 Entity, Installation Drawing No..... 50016326

Ex / I.S. data:

U_i (max)..... 30 VDC
 I_i (max)..... 120 mADC
 P_i (max)..... 0.84 W
 L_i (max)..... 10 μH
 C_i (max)..... 1.0 nF
 U_o (max)..... 9.6 VDC
 I_o (max)..... 28 mADC
 P_o (max)..... 67 m W
 L_o (max)..... 33 mH
 C_o (max)..... 3.5 μF

STT17H-BN Specification

Sensor Type	Basic Accuracy*		Rated Range		Standards	Minimum Span**	Temperature Effects per 1.0°C (1.8°F) Change in Ambient Temperature***	
	Fixed	% of Span	°C	°F			Fixed	% of Span
Pt100	0.2°C (0.36°F)	± 0.1	-200 to +850	-328 to +1562	IEC60751	10°C (18°F)	0.01°C (0.018°F)	±0.01
Pt1000	0.2°C (0.36°F)	± 0.1	-200 to +850	-328 to +1562	IEC60751	10°C (18°F)	0.01°C (0.018°F)	±0.01
Ni100	0.3°C (0.54°F)	± 0.1	-60 to +250	-76 to +482	DIN 43760	10°C (18°F)	0.01°C (0.018°F)	±0.01
B	1°C (1.8°F)	± 0.1	+400 to +1820	+752 to +3308	IEC584	100°C (180°F)	0.2°C (0.36°F)	±0.01
E	0.5°C (0.9°F)	± 0.1	-100 to +1000	-148 to +1832	IEC584	50°C (90°F)	0.05°C (0.09°F)	±0.01
J	0.5°C (0.9°F)	± 0.1	-100 to +1200	-148 to +2192	IEC584	50°C (90°F)	0.05°C (0.09°F)	±0.01
K	0.5°C (0.9°F)	± 0.1	-180 to +1372	-192 to +2502	IEC584	50°C (90°F)	0.05°C (0.09°F)	±0.01
L	0.5°C (0.9°F)	± 0.1	-100 to +900	-148 to +1652	DIN 43710	50°C (90°F)	0.05°C (0.09°F)	±0.01
N	0.5°C (0.9°F)	± 0.1	-180 to +1300	-292 to +2372	IEC584	50°C (90°F)	0.05°C (0.09°F)	±0.01
R	1°C (1.8°F)	± 0.1	-50 to +1760	-58 to +3200	IEC584	100°C (180°F)	0.2°C (0.36°F)	±0.01
S	1°C (1.8°F)	± 0.1	-50 to +1760	-58 to +3200	IEC584	100°C (180°F)	0.2°C (0.36°F)	±0.01
T	0.5°C (0.9°F)	± 0.1	-200 to +400	-328 to +752	IEC584	50°C (90°F)	0.05°C (0.09°F)	±0.01
U	0.5°C (0.9°F)	± 0.1	-200 to +600	-328 to +1112	DIN 43710	50°C (90°F)	0.05°C (0.09°F)	±0.01
W3	1°C (1.8°F)	± 0.1	0 to +2300	+32 to +4172	ASTM E988-90	100°C (180°F)	0.2°C (0.36°F)	±0.01
W5	1°C (1.8°F)	± 0.1	0 to +2300	+32 to +4172	ASTM E988-90	100°C (180°F)	0.2°C (0.36°F)	±0.01
Ω	0.1 Ω	± 0.1	0 to 7000 Ω			25 Ω	5 mΩ	±0.01
mV	10 μV	± 0.1	-800 to 800 mV			5 mV	0.5 μV	±0.01

*whichever is greater; Total Reference Accuracy = Basic Accuracy + CJ Accuracy (T/C only)

**or 50% of upper range value, whichever is greater

*** reference temperature 24°C

OPERATING CONDITIONS

Ambient temperature, rated..... -40 to 85°C (-40 to 185°F)

Humidity..... 0 to 95% RH (non-cond.)

Vibration..... Max 4g over 25 to 100Hz

Cold junction accuracy..... ±1.0°C

ELECTRICAL INPUT SPECIFICATIONS

Supply Voltage..... 8 to 35 VDC

Power supply voltage effect..... ≤ 0.005% of span per VDC

Warm-up time..... 30 sec

Response time (programmable)..... 1 to 60 sec

Galvanic isolation..... 1500 VAC

CURRENT OUTPUT SPECIFICATIONS

Signal output range..... 4 to 20 mA

Update time..... 440 msec

Load resistance (Ω)..... ≤(V supply - 8) / 0.023 A
0 to 1174 Ω

ALARM LEVELS

Programmable..... 3.5 to 4 mA downscale

20 to 23 mA upscale

NAMUR NE43 Upscale..... 23 mA

NAMUR NE43 Downscale..... 3.5 mA

APPROVALS

Observed Authority requirements:


Standard:

EMC 2004/108/EC

Emmission and immunity EN 61326

ATEX 94/9/EC..... EN 60079-0, EN 60079-15

Ex / I.S. approval:

KEMA 06 ATEX 0043 X.....  II 3 GD, T80°C...T105°C
EEx nA [L] IIC T4...T6

Applicable in zone..... 2

Max. amb. Temperature for T4..... 85°C

Max. amb. Temperature for T6..... 60°C

Vmax..... 35V

STT17F-BS Specifications

Sensor Type	Basic Accuracy*		Rated Range		Standards	Temperature Effects per 1.0°C (1.8°F) Change in Ambient Temperature**	
	Fixed	% of reading	°C	°F		Fixed	% of reading
Pt100	0.2°C (0.36°F)	± 0.1	-200 to +850	-328 to +1562	IEC60751	0.01°C (0.018°F)	±0.01
Pt1000	0.2°C (0.36°F)	± 0.1	-200 to +850	-328 to +1562	IEC60751	0.01°C (0.018°F)	±0.01
Ni100	0.3°C (0.54°F)	± 0.1	-60 to +250	-76 to +482	DIN 43760	0.01°C (0.018°F)	±0.01
Cu10	1.3°C (2.3°F)	± 0.1	-50 to +200	-58 to +392	α = 0.00427	0.02°C (0.036°F)	±0.01
B	1°C (1.8°F)	± 0.1	+400 to +1820	+752 to +3308	IEC584	0.2°C (0.36°F)	±0.01
E	0.5°C (0.9°F)	± 0.1	-100 to +1000	-148 to +1832	IEC584	0.05°C (0.09°F)	±0.01
J	0.5°C (0.9°F)	± 0.1	-100 to +1200	-148 to +2192	IEC584	0.05°C (0.09°F)	±0.01
K	0.5°C (0.9°F)	± 0.1	-180 to +1372	-192 to +2502	IEC584	0.05°C (0.09°F)	±0.01
L	0.5°C (0.9°F)	± 0.1	-200 to +900	-328 to +1652	DIN 43710	0.05°C (0.09°F)	±0.01
N	0.5°C (0.9°F)	± 0.1	-180 to +1300	-292 to +2372	IEC584	0.05°C (0.09°F)	±0.01
R	1°C (1.8°F)	± 0.1	-50 to +1760	-58 to +3200	IEC584	0.2°C (0.36°F)	±0.01
S	1°C (1.8°F)	± 0.1	-50 to +1760	-58 to +3200	IEC584	0.2°C (0.36°F)	±0.01
T	0.5°C (0.9°F)	± 0.1	-200 to +400	-328 to +752	IEC584	0.05°C (0.09°F)	±0.01
U	0.5°C (0.9°F)	± 0.1	-200 to +600	-328 to +1112	DIN 43710	0.05°C (0.09°F)	±0.01
W3	1°C (1.8°F)	± 0.1	0 to +2300	+32 to +4172	ASTM E988-90	0.2°C (0.36°F)	±0.01
W5	1°C (1.8°F)	± 0.1	0 to +2300	+32 to +4172	ASTM E988-90	0.2°C (0.36°F)	±0.01
Ω	0.05 Ω	± 0.1	0 to 10000 Ω			2 mΩ	±0.01
mV	10 μV	± 0.1	-800 to 800 mV			0.2 μV	±0.01

*whichever is greater; Total Reference Accuracy = Basic Accuracy + C/J Accuracy (T/C only)
** reference temperature 24°C

OPERATING CONDITIONS

Ambient temperature, rated.....-40 to 85°C (-40 to 185°F)
Humidity.....0 to 95% RH (non-cond.)
Vibration.....Max 4g over 25 to 100Hz
Cold junction accuracy.....±0.5°C

ELECTRICAL INPUT SPECIFICATIONS

Supply Voltage.....9 to 30 VDC
In FISCO installations.....9 to 17.5 VDC
Consumption.....< 11 mA
Warm-up time.....30 sec
Response time (programmable).....1 to 60 sec
Galvanic isolation.....1500 VAC
Update time.....< 400 msec
Execution time, PID controller.....< 200 msec
Execution time, analogue input.....< 50 msec

OUTPUT SPECIFICATIONS

Foundation™ Fieldbus connection:

Foundation™ Fieldbus version.....ITK 4.6
Foundation™ F. capability.....Basic or LAS
Foundation™ F. function blocks.....2 analogue and 1 PID


Ex / I.S. data:

Unit	Class I, Zone 0, EEx ia IIC, Entity/FISCO			
	IS, Class I, Division 1, Group A, B, C, D, Entity/FISCO			
	Barrier where Po < 0.84 W	Barrier where Po < 1.3 W	Suitable for FISCO systems	Suitable for FISCO systems
Ui	30 VDC	30 VDC	17.5 VDC	15 VDC
li	120 mADC	300 mADC	250 mADC	900 mADC
Pi	0.84 W	1.3 W	2.0 W	5.32 W
Li	1 μH	1 μH	1 μH	1 μH
Ci	2.0 nF	2.0 nF	2.0 nF	2.0 nF
T1...T4	Tamb. < 85°C	Tamb. < 75°C	Tamb. < 85°C	Tamb. < 85°C
T5	Tamb. < 70°C	Tamb. < 65°C	Tamb. < 60°C	Tamb. < 60°C
T6	Tamb. < 60°C	Tamb. < 45°C	Tamb. < 45°C	Tamb. < 45°C

APPROVALS

Observed Authority requirements: Standard:
EMC 2004/108/EC
Emmission and immunity EN 61326
ATEX 94/9/EC.....EN 50014, EN 50020, EN 50281-1-1, EN 50284, and IEC 60079-27 (FISCO)
FM, ASCN.....3600, 3611, 3610
CSA, CAN / CSA.....C22.2 No. 142, No. 157
CAN / CSA.....E60079-0, E60079-11, E60079-15, UL913, UL1604

Ex / I.S. approval:

KEMA 06 ATEX 0046..... II 1 GD, T65°C...T105°C
EEx ia IIC T4...T6
Ex II 2(1) GD, T65oC...T105oC
EEx ib [ia] IIC T4...T6
Applicable in zone.....0, 1, 2, 20, 21 or 22
FM, applicable in.....IS, CL I, DIV 1, Grp. A-D, T4...T6
AEx ia IIC
NI, CL I, DIV 2, Grp. A-D, T4...T6
Entity, FM Installation Drawing No.....50016325
CSA, applicable in.....IS, CL I, DIV 1, Grp. A-D, T4...T6
Ex ia IIC, AEx ia IIC
CL I, DIV 2, Grp. A-D, T4...T6
Entity, CSA Installation Drawing No.....50016325

Ex / I.S. data:

Unit	Class I, Zone 1, EEx ib IIC, Entity/FISCO	
	IS, Class I, Division 2, Group A, B, C, D, Entity/FISCO	
	Barrier where Po < 5.32 W	FISCO segment coupler
Ui	30 VDC	17.5 VDC
li	250 mADC	All
Pi	5.32 W	All
Li	1 μH	1 μH
Ci	2.0 nF	2.0 nF
T1...T4	Tamb. < 85°C	Tamb. < 85°C
T5	Tamb. < 75°C	Tamb. < 75°C
T6	Tamb. < 60°C	Tamb. < 60°C

STT17F-BN Specifications

Sensor Type	Basic Accuracy*		Rated Range		Standards	Temperature Effects per 1.0°C (1.8°F) Change in Ambient Temperature**	
	Fixed	% of reading	°C	°F		Fixed	% of reading
Pt100	0.2°C (0.36°F)	± 0.1	-200 to +850	-328 to +1562	IEC60751	0.01°C (0.018°F)	±0.01
Pt1000	0.2°C (0.36°F)	± 0.1	-200 to +850	-328 to +1562	IEC60751	0.01°C (0.018°F)	±0.01
Ni100	0.3°C (0.54°F)	± 0.1	-60 to +250	-76 to +482	DIN 43760	0.01°C (0.018°F)	±0.01
Cu10	1.3°C (2.3°F)	± 0.1	-50 to +200	-58 to +392	$\alpha = 0.00427$	0.02°C (0.036°F)	±0.01
B	1°C (1.8°F)	± 0.1	+400 to +1820	+752 to +3308	IEC584	0.2°C (0.36°F)	±0.01
E	0.5°C (0.9°F)	± 0.1	-100 to +1000	-148 to +1832	IEC584	0.05°C (0.09°F)	±0.01
J	0.5°C (0.9°F)	± 0.1	-100 to +1200	-148 to +2192	IEC584	0.05°C (0.09°F)	±0.01
K	0.5°C (0.9°F)	± 0.1	-180 to +1372	-192 to +2502	IEC584	0.05°C (0.09°F)	±0.01
L	0.5°C (0.9°F)	± 0.1	-200 to +900	-328 to +1652	DIN 43710	0.05°C (0.09°F)	±0.01
N	0.5°C (0.9°F)	± 0.1	-180 to +1300	-292 to +2372	IEC584	0.05°C (0.09°F)	±0.01
R	1°C (1.8°F)	± 0.1	-50 to +1760	-58 to +3200	IEC584	0.2°C (0.36°F)	±0.01
S	1°C (1.8°F)	± 0.1	-50 to +1760	-58 to +3200	IEC584	0.2°C (0.36°F)	±0.01
T	0.5°C (0.9°F)	± 0.1	-200 to +400	-328 to +752	IEC584	0.05°C (0.09°F)	±0.01
U	0.5°C (0.9°F)	± 0.1	-200 to +600	-328 to +1112	DIN 43710	0.05°C (0.09°F)	±0.01
W3	1°C (1.8°F)	± 0.1	0 to +2300	+32 to +4172	ASTM E988-90	0.2°C (0.36°F)	±0.01
W5	1°C (1.8°F)	± 0.1	0 to +2300	+32 to +4172	ASTM E988-90	0.2°C (0.36°F)	±0.01
Ω	0.05 Ω	± 0.1	0 to 10000 Ω			2 m Ω	±0.01
mV	10 μ V	± 0.1	-800 to 800 mV			0.2 μ V	±0.01

*whichever is greater; Total Reference Accuracy = Basic Accuracy + CJ Accuracy (T/C only)
** reference temperature 24°C

OPERATING CONDITIONS

Ambient temperature, rated..... -40 to 85°C (-40 to 185°F)
Humidity..... 0 to 95% RH (non-cond.)
Vibration..... Max 4g over 25 to 100Hz
Cold junction accuracy..... ±0.5°C
Reference temperature..... 20 to 28°C

ELECTRICAL INPUT SPECIFICATIONS

Supply Voltage..... 9 to 32 VDC
Consumption..... < 11 mA
Warm-up time..... 30 sec
Response time (programmable)..... 1 to 60 sec
Galvanic isolation..... 1500 VAC
Update time..... < 400 msec
Execution time, PID controller..... < 200 msec
Execution time, analogue input..... < 50 msec


OUTPUT SPECIFICATIONS

Foundation™ Fieldbus connection:

Foundation™ Fieldbus version..... ITK 4.6
Foundation™ F. capability..... Basic or LAS
Foundation™ F. function blocks..... 2 analogue and 1 PID

APPROVALS

Observed Authority requirements: Standard:

EMC 2004/108/EC
Emmission and immunity EN 61326
ATEX 94/9/EC..... EN 60079-0, EN 60079-15
FM, ASCN..... 3600, 3611
CSA, CAN / CSA..... C22.2 No. 142, No. 213
CAN / CSA..... E60079-0, E60079-15, UL1604
Ex / I.S. approval:
KEMA 06 ATEX 0045 X.....  II 3 G
EEx nA [L] IIC T4...T6
Applicable in zone..... 2
FM, applicable in..... NI, CL I, DIV 2, Grp. A-D, T4...T6
FNICO
Entity, FM Installation Drawing No..... 50016325
CSA, applicable in..... CL I, DIV 2, Grp. A-D, T4...T6
CL I, Zone 2,
Ex nA IIC, AEx nA IIC
Entity, CSA, Installation Drawing No.... 50016325
Max. amb. Temperature for T4..... 85°C
Max. amb. Temperature for T6..... 60°C

Vmax..... 32V
Li..... 1 μ H
Ci..... 2.0 nF

STT171 Custom Configuration Data Sheet

Customer P.O. Number _____

Line Item _____

Model Number _____

Tag Number (max 15 char) _____

Honeywell Sales Order Number _____

Sensor Type:

- Pt100
- Ni100
- Ohms

Output Values:

4 mA Value:

- _____ °C
- _____ °F
- _____ Ohms

20 mA Value:

- _____ °C
- _____ °F
- _____ Ohms

Response time:

_____ (0.33 – 60 sec)

Output Limits:

- Span (4 to 20 mA)
- Max (3.5 to 23 mA)
- Specify Low _____ mA, High _____ mA
- NAMUR NE 43 (3.8 to 20.5 mA)

Sensor Error Action:

- Off
- Specify _____ mA
- NAMUR NE 43 upscale (23 mA)
- NAMUR NE 43 downscale (3.5 mA)

STT173 Custom Configuration Data Sheet

Customer P.O. Number _____

Line Item _____

Model Number _____

Tag Number (max 15 char) _____

Honeywell Sales Order Number _____

Sensor Type:

- Pt100
- Ni100

Wiring:

- 2-wire
- 3-wire
- 4-wire

- Ohms
- mV

- Type B T/C
- Type E T/C
- Type J T/C
- Type K T/C
- Type L T/C
- Type N T/C
- Type R T/C
- Type S T/C
- Type T T/C
- Type U T/C
- Type W3 T/C
- Type W5 T/C

Cold Junction Compensation:

- Internal
- External / Pt100
- External / Ni100

Output Values:

4 mA Value:

- _____ °C
- _____ °F
- _____ mV
- _____ Ohms

20 mA Value:

- _____ °C
- _____ °
- _____ mV
- _____ Ohms

Response time:

_____ (1 – 60 sec)

Output Limits:

- Span (4 to 20 mA)
- Max (3.5 to 23 mA)
- Specify Low _____ mA, High _____ mA
- NAMUR NE 43 (3.8 to 20.5 mA)

Sensor Error Action:

- Off
- Specify _____ mA
- NAMUR NE 43 upscale (23 mA)
- NAMUR NE 43 downscale (3.5 mA)

STT17H Custom Configuration Data Sheet

Customer P.O. Number _____

Line Item _____

Model Number _____

Tag Number (max 15 char) _____

Honeywell Sales Order Number _____

Sensor Input:

- Single Sensor
- Duplex Sensor (Average)
- Duplex Sensor (Differential)

Sensor Type:

- | | |
|---------------------------------|--------------------------------------|
| <input type="checkbox"/> Pt100 | <input type="checkbox"/> Type B T/C |
| <input type="checkbox"/> Ni100 | <input type="checkbox"/> Type E T/C |
| | <input type="checkbox"/> Type J T/C |
| | <input type="checkbox"/> Type K T/C |
| Wiring: | <input type="checkbox"/> Type L T/C |
| <input type="checkbox"/> 2-wire | <input type="checkbox"/> Type N T/C |
| <input type="checkbox"/> 3-wire | <input type="checkbox"/> Type R T/C |
| <input type="checkbox"/> 4-wire | <input type="checkbox"/> Type S T/C |
| <input type="checkbox"/> Ohms | <input type="checkbox"/> Type T T/C |
| <input type="checkbox"/> mV | <input type="checkbox"/> Type U T/C |
| | <input type="checkbox"/> Type W3 T/C |
| | <input type="checkbox"/> Type W5 T/C |

Cold Junction Compensation:

- Internal
- External / Pt100
- External / Ni100

Output Values:

- | | |
|-------------------------------------|-------------------------------------|
| 4 mA Value: | 20 mA Value: |
| <input type="checkbox"/> _____ °C | <input type="checkbox"/> _____ °C |
| <input type="checkbox"/> _____ °F | <input type="checkbox"/> _____ ° |
| <input type="checkbox"/> _____ mV | <input type="checkbox"/> _____ mV |
| <input type="checkbox"/> _____ Ohms | <input type="checkbox"/> _____ Ohms |

Response time:
_____ (1 – 60 sec)

Output Limits:

- Span (4 to 20 mA)
- Max (3.5 to 23 mA)
- Specify Low _____ mA, High _____ mA
- NAMUR NE 43 (3.8 to 20.5 mA)

Sensor Error Action:

- Off
- Specify _____ mA
- NAMUR NE 43 upscale (23 mA)
- NAMUR NE 43 downscale (3.5 mA)

STTF Custom Configuration Data Sheet

Customer P.O. Number _____
Line Item _____
Model Number _____
Tag Number (max 15 char) _____
Honeywell Sales Order Number _____

TRANSDUCER BLOCK PARAMETERS

Temperature Units

- °C
- °F
- mV
- Ohms

Sensor Input

- Single Sensor
- Duplex Sensor (Average)
- Duplex Sensor (Differential #1 - #2)

Sensor Type (Sensor 1, Sensor 2)::

- Pt100
 - Ni100
 - Pt500
 - Pt1000
 - Ni100
 - Cu10
 - Type B T/C
 - Type E T/C
 - Type J T/C
 - Type K T/C
 - Type L T/C
 - Type N T/C
 - Type R T/C
 - Type S T/C
 - Type T T/C
 - Type U T/C
 - Type W3 T/C
 - Type W5 T/C
- Wiring:
- 2-wire
 - 3-wire
 - 4-wire
- Ohms
 - mV

Cold Junction Compensation:

- Internal
- External / Pt100 2-w
- External / Ni100 3-w

Sensor Error Detection:

Sensor #1

- Lead breakage and short circuit detection disable
- Lead breakage and short circuit enable
- Lead breakage detection enable, short circuit detection disable
- Lead breakage detection disable, short circuit detection enable

Sensor #2

- Lead breakage and short circuit detection disable
- Lead breakage and short circuit enable
- Lead breakage detection enable, short circuit detection disable
- Lead breakage detection disable, short circuit detection enable

Model Selection Guide (34-44-16-07)

Model Selection Guide
34-44-16-07 Issue 10

Instructions

- Choose Availability column based on Key Number.
- A dot (•) denotes unrestricted availability.
- Select the desired Key Number based on the desired communications protocol.
- Select options and approvals from Tables.

Key Number
STT17_ - I - II - III - IV - V - VI, options



Key Number

Description	Selection	Availability			
4-20mA Output, RTD input	STT171	↓			
4-20mA Output, universal input	STT173		↓		
HART Protocol, 4-20mA output	STT17H			↓	
Digital output, Foundation Fieldbus protocol	STT17F				↓
Configuration tool for STT171, 173 and 17H	STT17C				↓

Table I - Safety Approvals

Approval Body	Approval Type	Location or Classification	00	•	•	•	•
None	No approval body certifications included		00				•
FM, CSA, ATEX	Intrinsically Safe ENTITY Non-Incendive	Class I, Div. 1, Groups A,B,C,D, T4 Class I, Zone 0/1; AEx ia IIC, T4	BS	•	•	•	•
	Intrinsically Safe ENTITY Non-Incendive	Class I, Div. 2, Groups A,B,C,D, T4 Class I, Zone 0/1; Ex ia IIC, T4		•	•	•	•
	* Intrinsically Safe Zone 0/1	Ex II 1 GD, EEx ia IIC, T4..T6 Ex II 2 (1) GD, T4..T6		•	•	•	•
	Non-Incendive Zone 2	Class I, Div. 2, Groups A,B,C,D, T4 Ex II 3 G, EEx nA [L] T4..T6		•	•		
FM Approval	Intrinsically Safe ENTITY Non-Incendive	Class I, Div. 1, Groups A,B,C,D, T4 Class I, Zone 0/1; AEx ia IIC, T4	1G	e	e	e	e
	Intrinsically Safe ENTITY Non-Incendive	Class I, Div. 2, Groups A,B,C,D, T4 Class I, Zone 0/1; Ex ia IIC, T4	2G	e	e	e	e
ATEX	* Intrinsically Safe Zone 0/1	Ex II 1 GD, EEx ia IIC, T4..T6 Ex II 2 (1) GD, T4..T6	3S	e	e	e	
	Non-Incendive Zone 2	Class I, Div. 2, Groups A,B,C,D, T4 Ex II 3 G, EEx nA [L] T4..T6	3N				e

* Ex II 1 GD or II 2 (1) GD allows for installation in potentially explosive atmospheres caused by the presence of combustible dusts only when mounted in a metal enclosure of form B according to DIN 43729 (Head-Mount enclosure) that provides a degree of p

TABLE II - No Option

No Option	0	•	•	•	•	•
-----------	---	---	---	---	---	---

TABLE III - Configuration & Certificates

Configuration	None - Factory Default Configuration Supplied	0	•	•	•	•
	Custom Transmitter Configuration with Printed Report **	T	•	•	•	•
Calibration	Custom Transmitter Calibration with Printed Report **	C	•	•	•	
Optional Certificates	No Option	_0	•	•	•	•
	No Certificate of Conformance/Origin	_ _ 0	•	•	•	•
	Certificate of Conformance/Origin	_ _ R	•	•	•	•

Model Selection Guide, (34-ST-16-01)cont.

		STT17	Availability				
		Selection	1	3	H	F	C
			↓	↓	↓	↓	↓
TABLE IV - Transmitter Housing and Integral Meters (Reference EN01-6032 for details)							
Housing	No Housing Supplied	0__
	Field Mount Aluminum with Beige Epoxy Coating	E__	d	d	d	d	.
	Mount 316 Stainless Steel	T__	d	d	d	d	.
	Head Mt Type 4X housing - Beige	C__	g	g	g	g	.
Cable/Conduit Entry	Not Applicable - No Housing Supplied	_0_
	1/2" NPT Cable/ Conduit Entry	_N_
	M20 x 1.5 Cable/ Conduit Entry	_M_
Integral Meter	No Integral Meter Supplied	--0
	E.U. Meter for Field Mount Housing	--E	e	e	e	.	.

TABLE V - Optional Equipment

Mounting	No mounting bracket	0__
	Carbon steel pipe mounting bracket for 2" pipe	M__	e	e	e	e	.
	Stainless Steel mounting bracket for 2" pipe	S__	e	e	e	e	.
	Spring loading mounting set	L__	f	f	f	f	.
	DIN rail mounting clip (top hat or G rail)	D__	f	f	f	f	.
M20 adaptors	No adaptors required	_0_
	1 adaptor for M20 x 1.5 wiring entry	_1_
	2 adaptors for M20 x 1.5 wiring entry	_2_
3/4"NPT adaptors	1 adaptor for 3/4"NPT wiring entry	_3_	
Lightning Protection	No lightning protection supplied	--0
	Externally Mountable to Field Mount Housing	--L
	Internal lightning protection	--S

TABLE VI - Additional Features

No Selection		00
Optional Extended Warranty	Additional Warranty - 1 year	W1
Customer Tagging	316 SS Wired-on Customer I.D. Tag (4 lines, 28 chars. per line, customer specified information)	TG
	316 SS Wired-on Customer I.D. Tag (blank)	TB
Operator's Manual	STT171 Version; English, French, German Language	M1
	STT173 Version; English, French, German Language	M3
	STT17H Version; English, French, German Language	MH
	STT17F Version; English, French, German Language	MF

RESTRICTIONS

Restriction Letters	Available Only With		Not Available With	
	Table	Selection	Table	Selection
b	VI	Select only one option from this group		
d	IV	_N_		
e	IV	E__ or T__		
f	IV	0__		
g	IV			_0E

ACCESSORIES

	Part Number
DIN rail clip	50017860-001

** If Custom Configuration option "T" or the Custom Calibration option "C" is ordered, the configuration or calibration information required must be entered as a note on the order. Any of the following elements can be included, based on the selected mo

(STT171, STT173, STT17H) Tag Number, CJC, Sensor Type, Sensor Wiring, Temperature Units, URV/LRV, Output Range, Output Limits, Sensor Error Action, Response Time.

(STT17F) Tag Number, Sensor Type, URV/LRV, Burnout- High or Low, Response Time

*** Refer to Part Price List (PPL) or ICOM for pricing.

This page has bee intentionally left blank

HART* is a trademark of the Hart Communication Foundation.
FOUNDATION™ is a trademark of the Fieldbus Foundation.

Honeywell

Honeywell Process Solutions

2500 W. Union Hill Drive
Phoenix, Arizona 85027
Tel: 877.466.3993 or 602.313.6665

www.honeywell.com/ps

34-TT-03-07
January 2009
© 2009 Honeywell International Inc.